
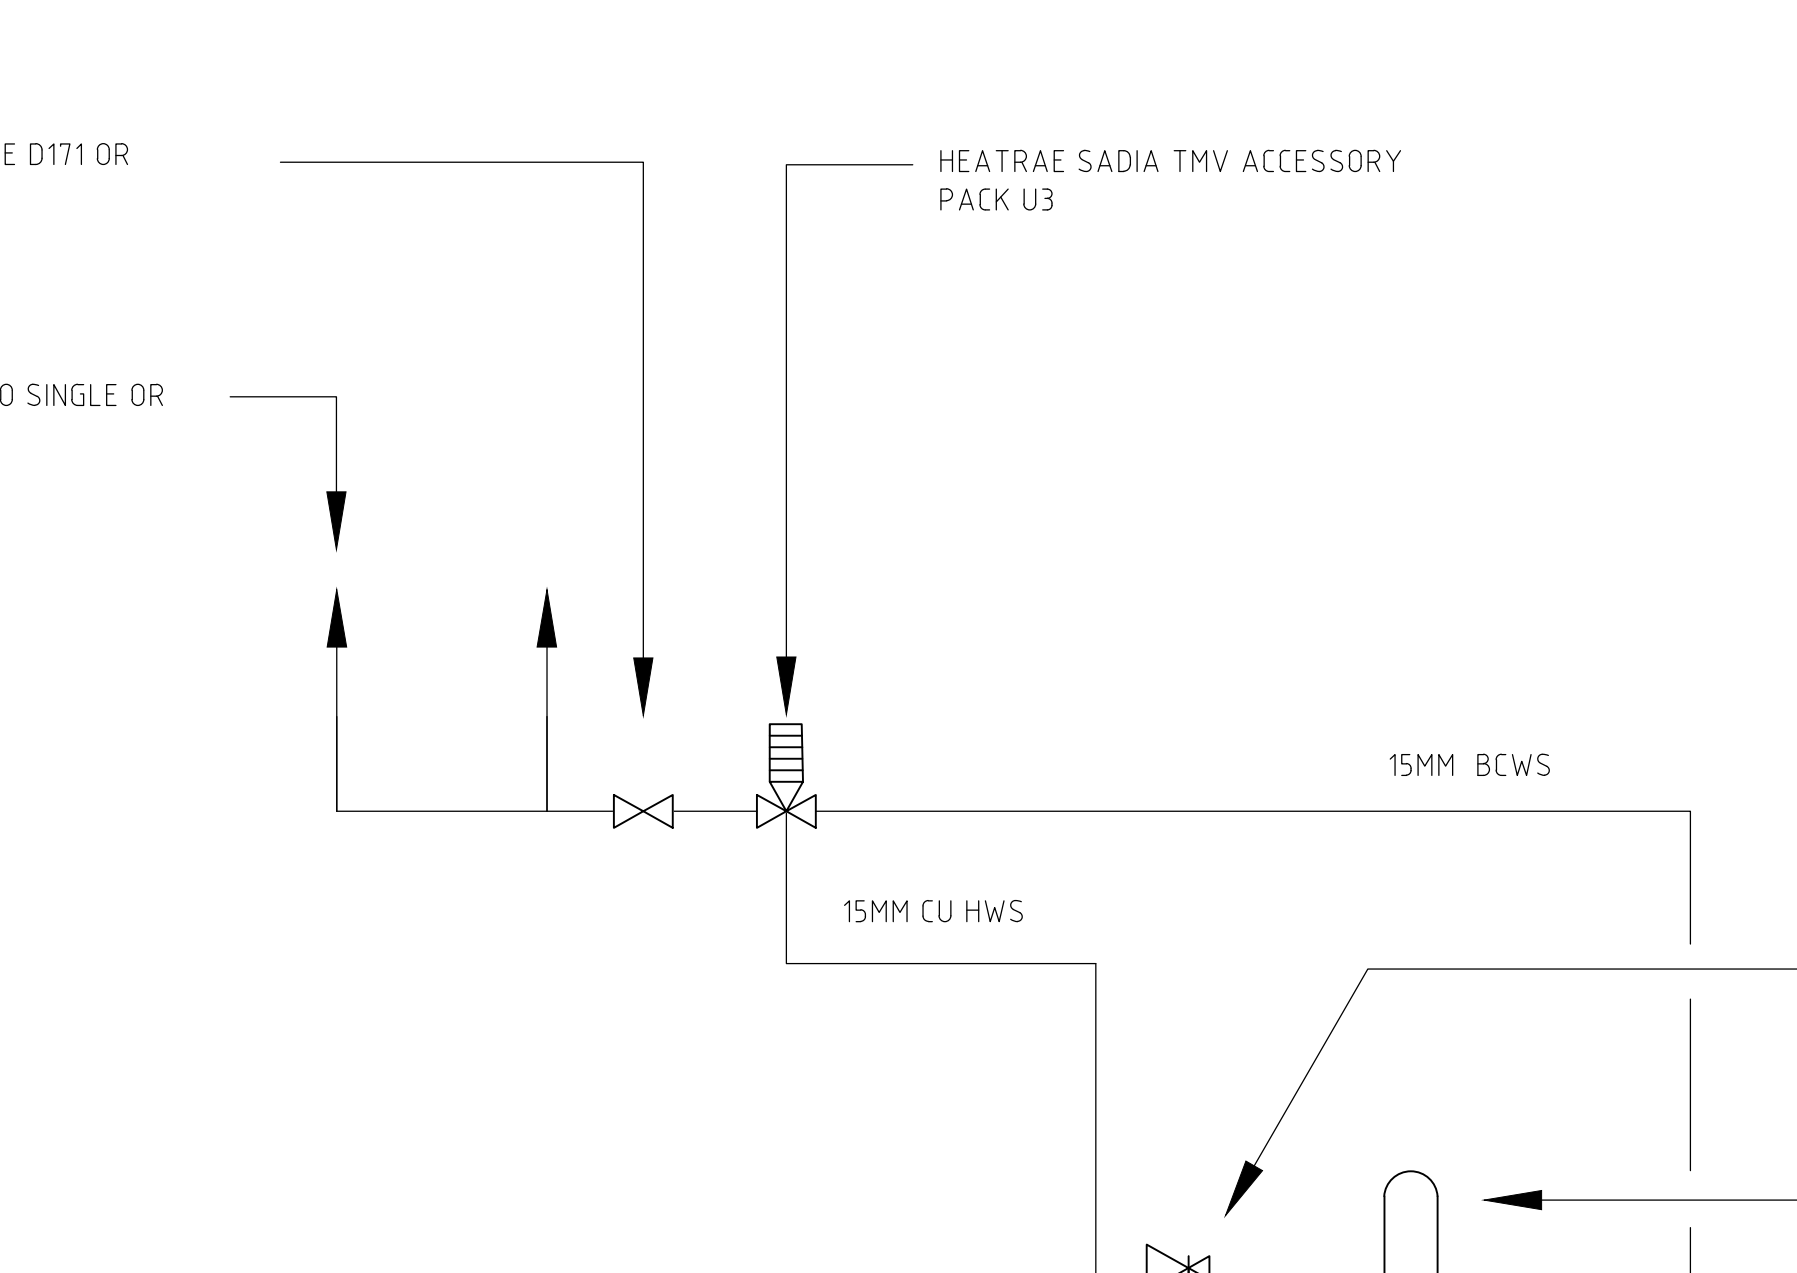


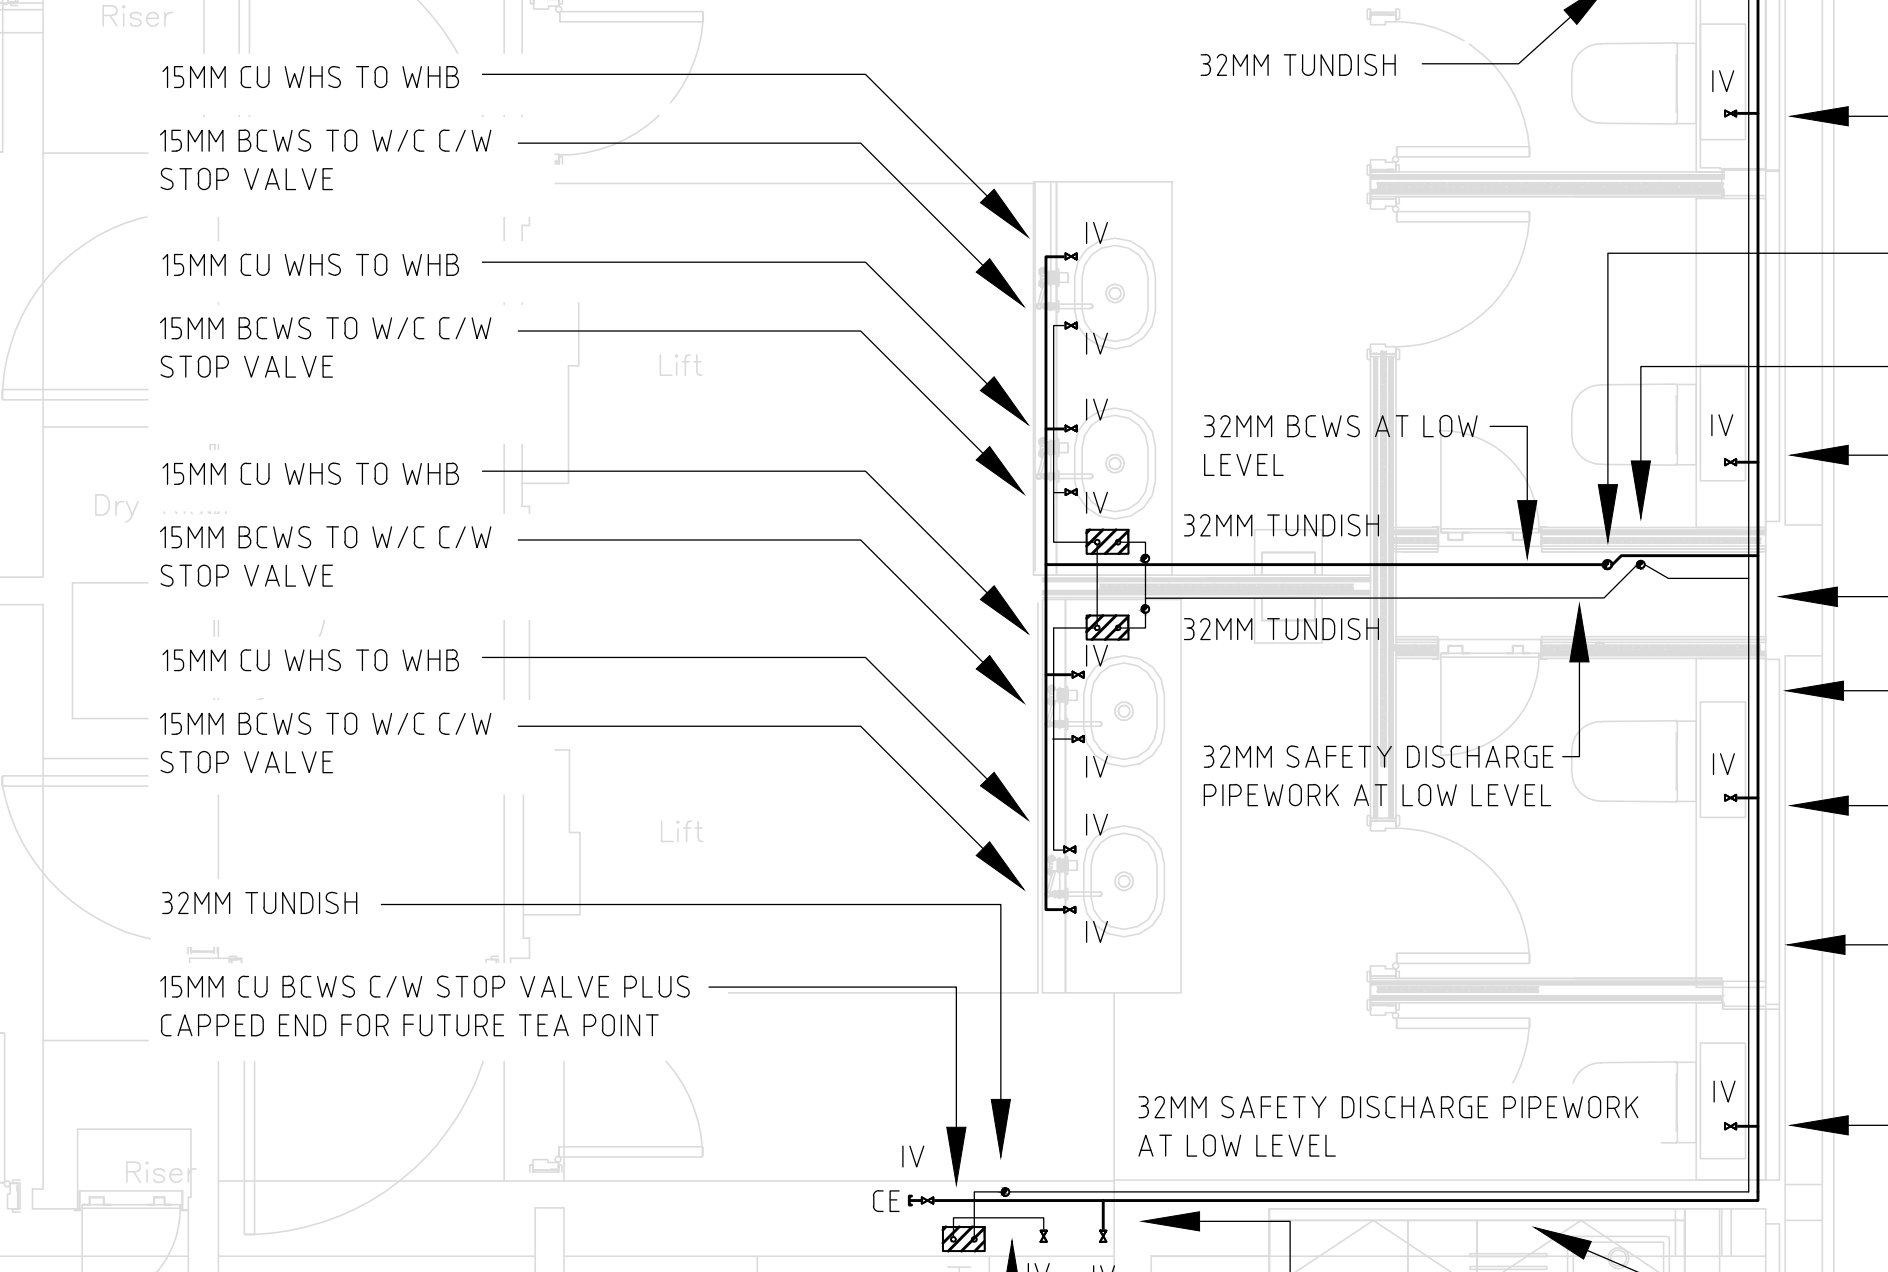

- | | |
|-------|---------------------------------|
| MWS | -MAINS WATER SERVICE |
| CWS | -COLD WATER SERVICE |
| BCWS | -BOOSTED COLD WATER SERVICE |
| HWS | -HOT WATER SERVICE |
| GWS | -GREY WATER SERVICE |
| HWHS | -LAB HOT WATER SERVICE |
| LBCWS | -LAB BOOSTED COLD WATER SERVICE |
| IV | -ISOLATING VALVE |
| DC | -DRAIN COCK |
| AV | -AIR VENT |
| TBV | -THERMAL BALANCING VALVE |
| CRV | -CIRCULATION CONTROL VALVE |
| TS | -TEMPERATURE SENSOR |
| FM | -FLOW METER |
| MV | -MOTORIZED VALVE |
| FS | -FLOW SENSOR |
| SCV | -SINGLE CHECK VALVE |
| DCV | -DOUBLE CHECK VALVE |
| FLX | -FLEXIBLE CONNECTION |
| PRV | -PRESSURE RELEASE VALVE |
| DTLL | -DROP TO LOW LEVEL |
| TA | -TO ABOVE |
| TB | -TO BELOW |
| FA | -FROM ABOVE |
| FB | -FROM BELOW |

BAILEY ASSOCIATES

0	TENDER	SCB	09/11/17
Rev	Description	Chkd	Date
Details 49-59 OLD STREET HOT & COLD WATER SERVICES SIXTH FLOOR LAYOUT			
Job number	Status	Drawing No	Rev

Job number	Status	Drawing No	Rev
17312-HAC-WS-116			