


Welsh Slate
+44 (0) 1248 600656 www.welshslate.com

Parapet / Box Gutter Detail
Penrhyn Heather Blue 500x300 County 7.0mm

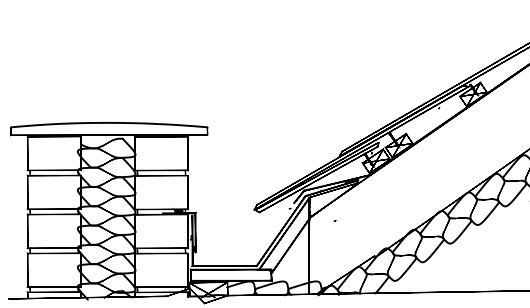

Provide continuous support for lead gutter with 25 mm timber treated for external applications in stepped sections (min 60 mm step height) to comply with the maximum dimensions recommended by the Lead Sheet Association (LSA).

A tilting fillet of height equal to batten height + 2 x thickness of slate should be fixed with any eaves carrier or eaves sheet underlay to ensure support of underlay into the gutter.

Provide lead lining (minimum Code 5) to the gutter sections ensuring maximum length and width dimensions set out by the LSA are complied with. The up stand from the sole of the valley to the top edge of the lead lining should be 100 mm minimum.

The exposed top edge of the gutter lining should be overlapped by a minimum of 75 mm with a Code 4 or 5 lead cover flashing, wedged at overlaps and 450 mm centres.

Trim to size under eave slate to provide 45-55 mm overhang and maintain headlap.

Fix under eave slate with two nails (approx 25 mm from the top and side) face downwards.

