RevNo	Revision note	Date	Signature	Checked

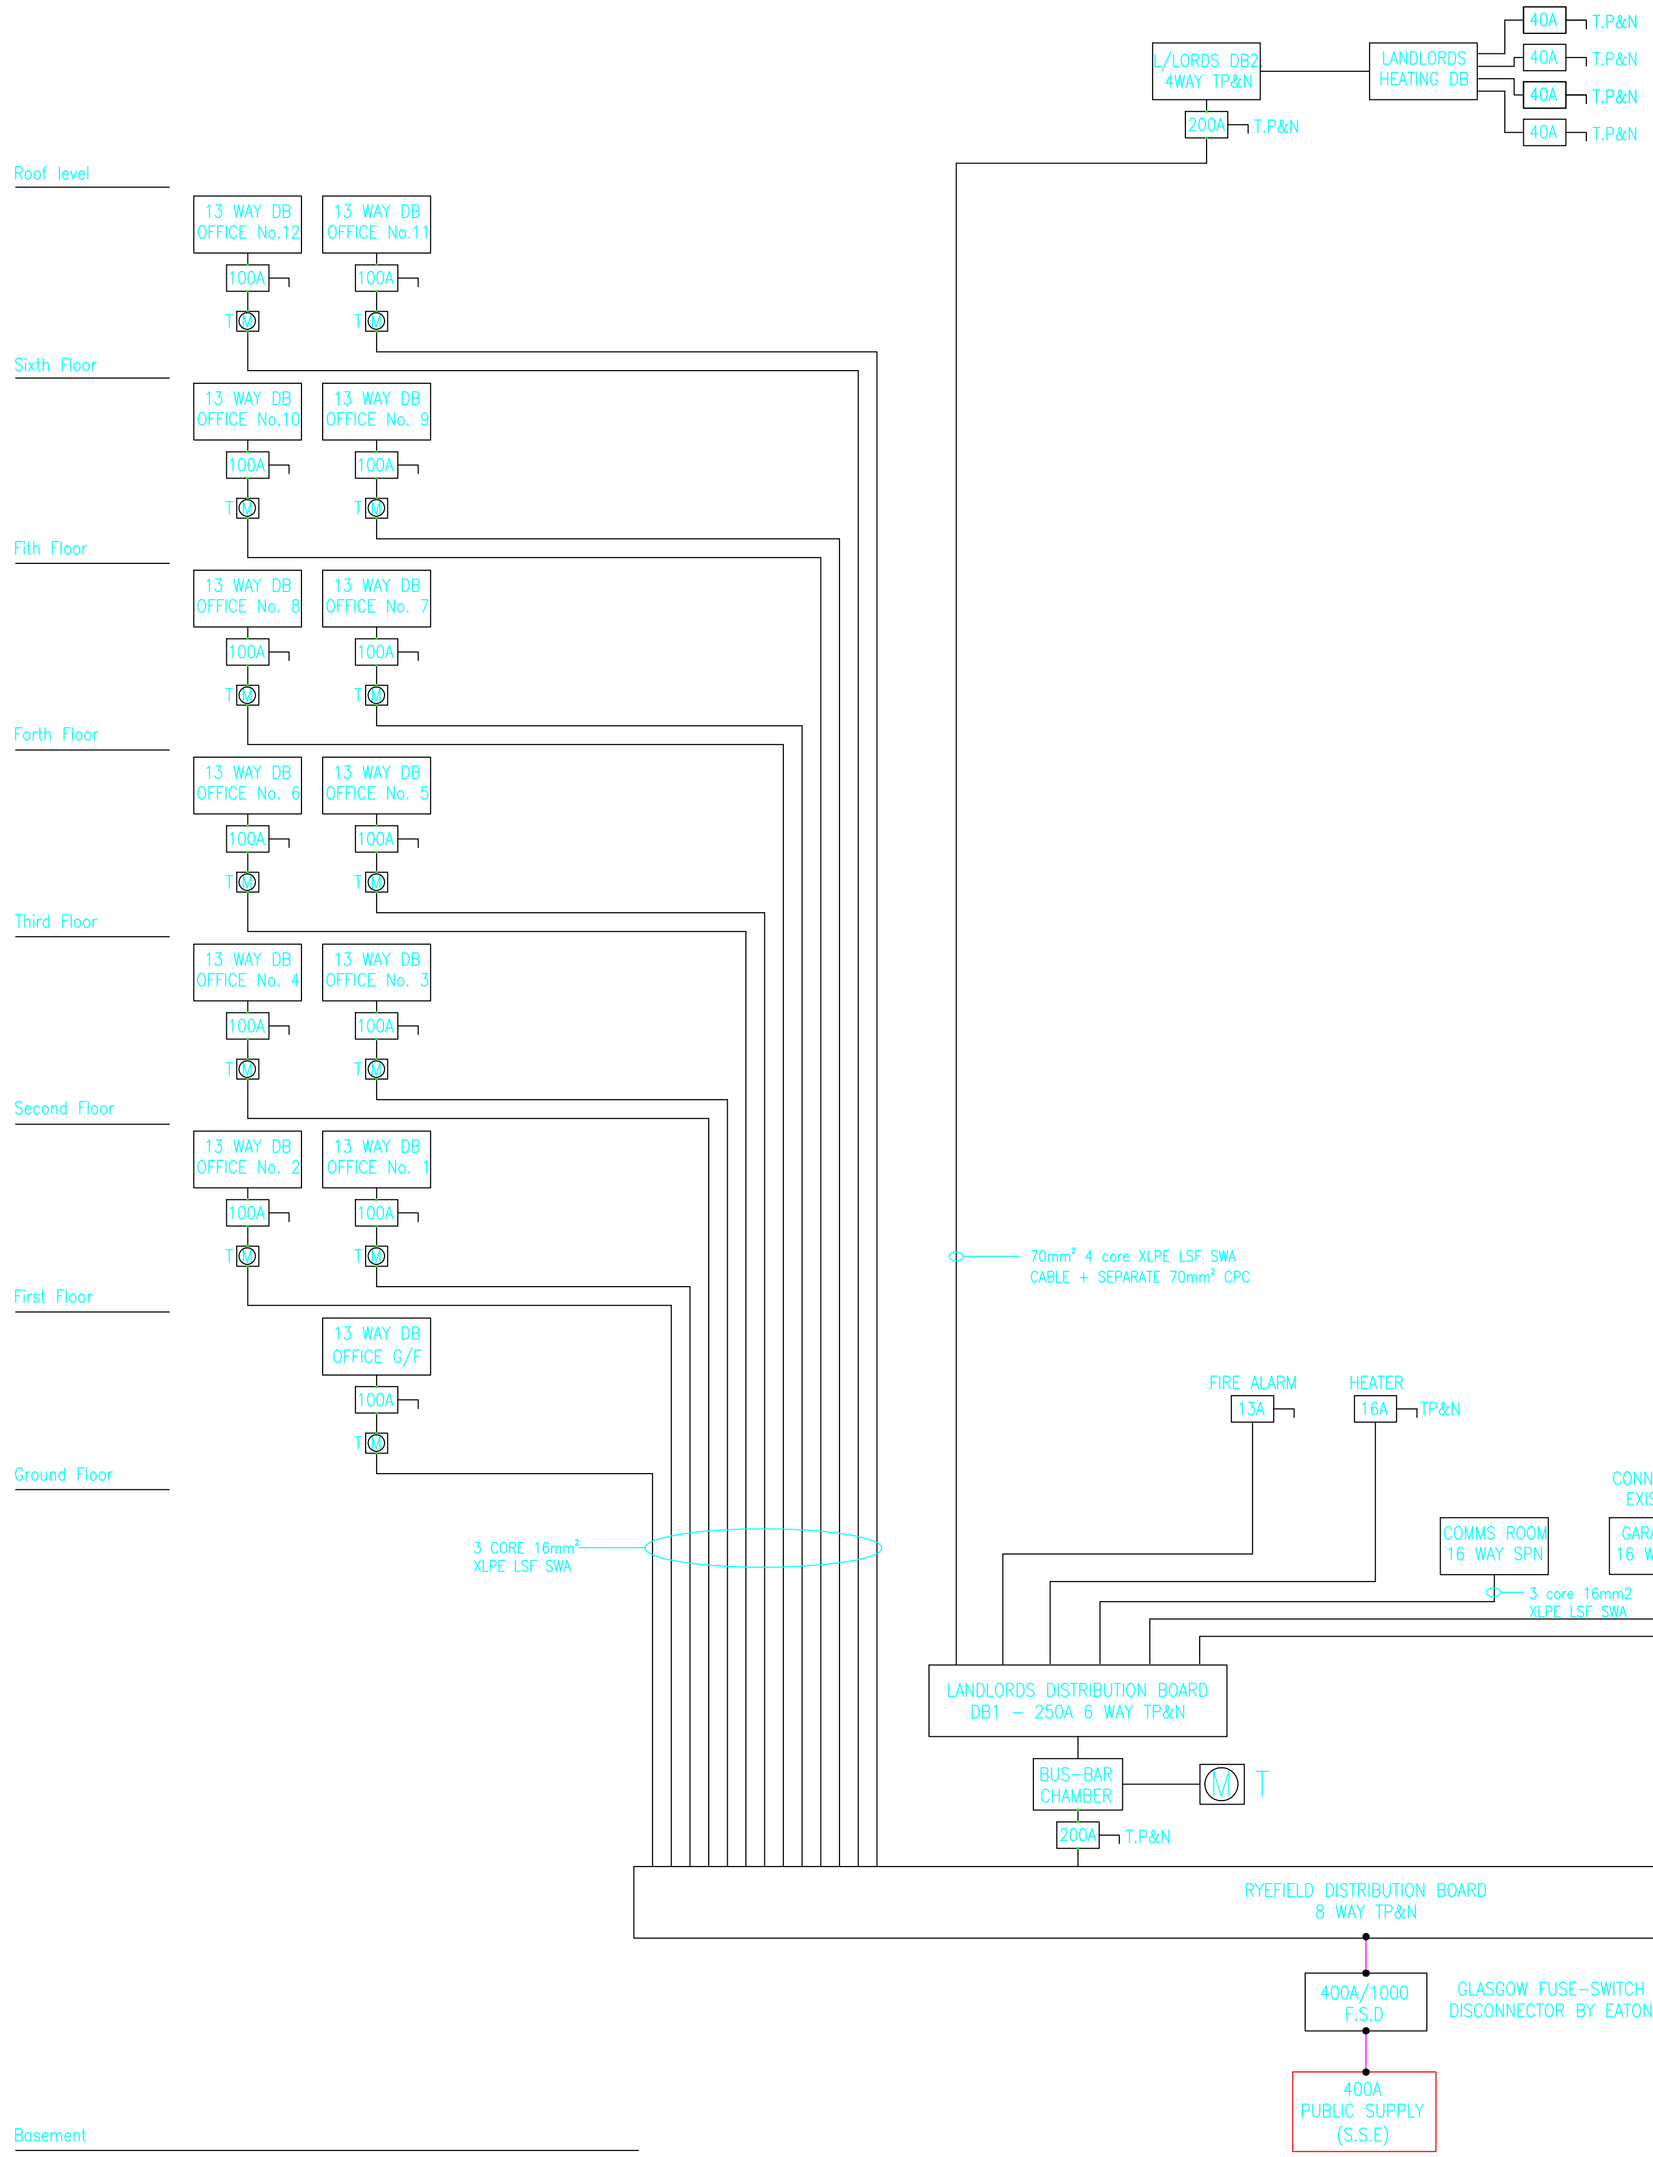

NOTES:

ALL SUPPLIES RUNNING UP THROUGH THE BUILDING SHALL BE FIXED TO GALVANIZED CABLE TRAY, MOUNTED WITHIN THE MAIN ELECTRICAL RISER IN THE CENTER OF THE LIFT LOBBY OR ON CABLE TRAY ABOVE THE NEW FALSE CEILING. ALL CABLE FIXINGS SHALL BE 30 MINUTE FIRE RATED

SMALL POWER CIRCUITS TO BE PROTECTED BY RCBO'S

LANDLORDS LIGHTING AND SMALL POWER SHALL EMANATE EITHER DB1 OR DB2

ALL CONTROL AND DISTRIBUTION EQUIPMENT TO BE BY EATON LTD OR RYEFIELD LTD.

SYMBOLS LEGEND

FUSED DISCONNECTOR BY EATON SIZE AS INDICATED

T TARIFF METER

Itemref	Quantity	Title/Name, designation, material, dimension etc		Article No./Reference	
Designed by Ben Jones		Checked by bj	Approved by - date N/A	Filename Preliminary	Date 04/09/17	Scale 1:200 @ A1
Rosiek Ltd		Mains Distribution Schematic			
		Dwg. No. 17020-T-220		Edition	Sheet 1/1