


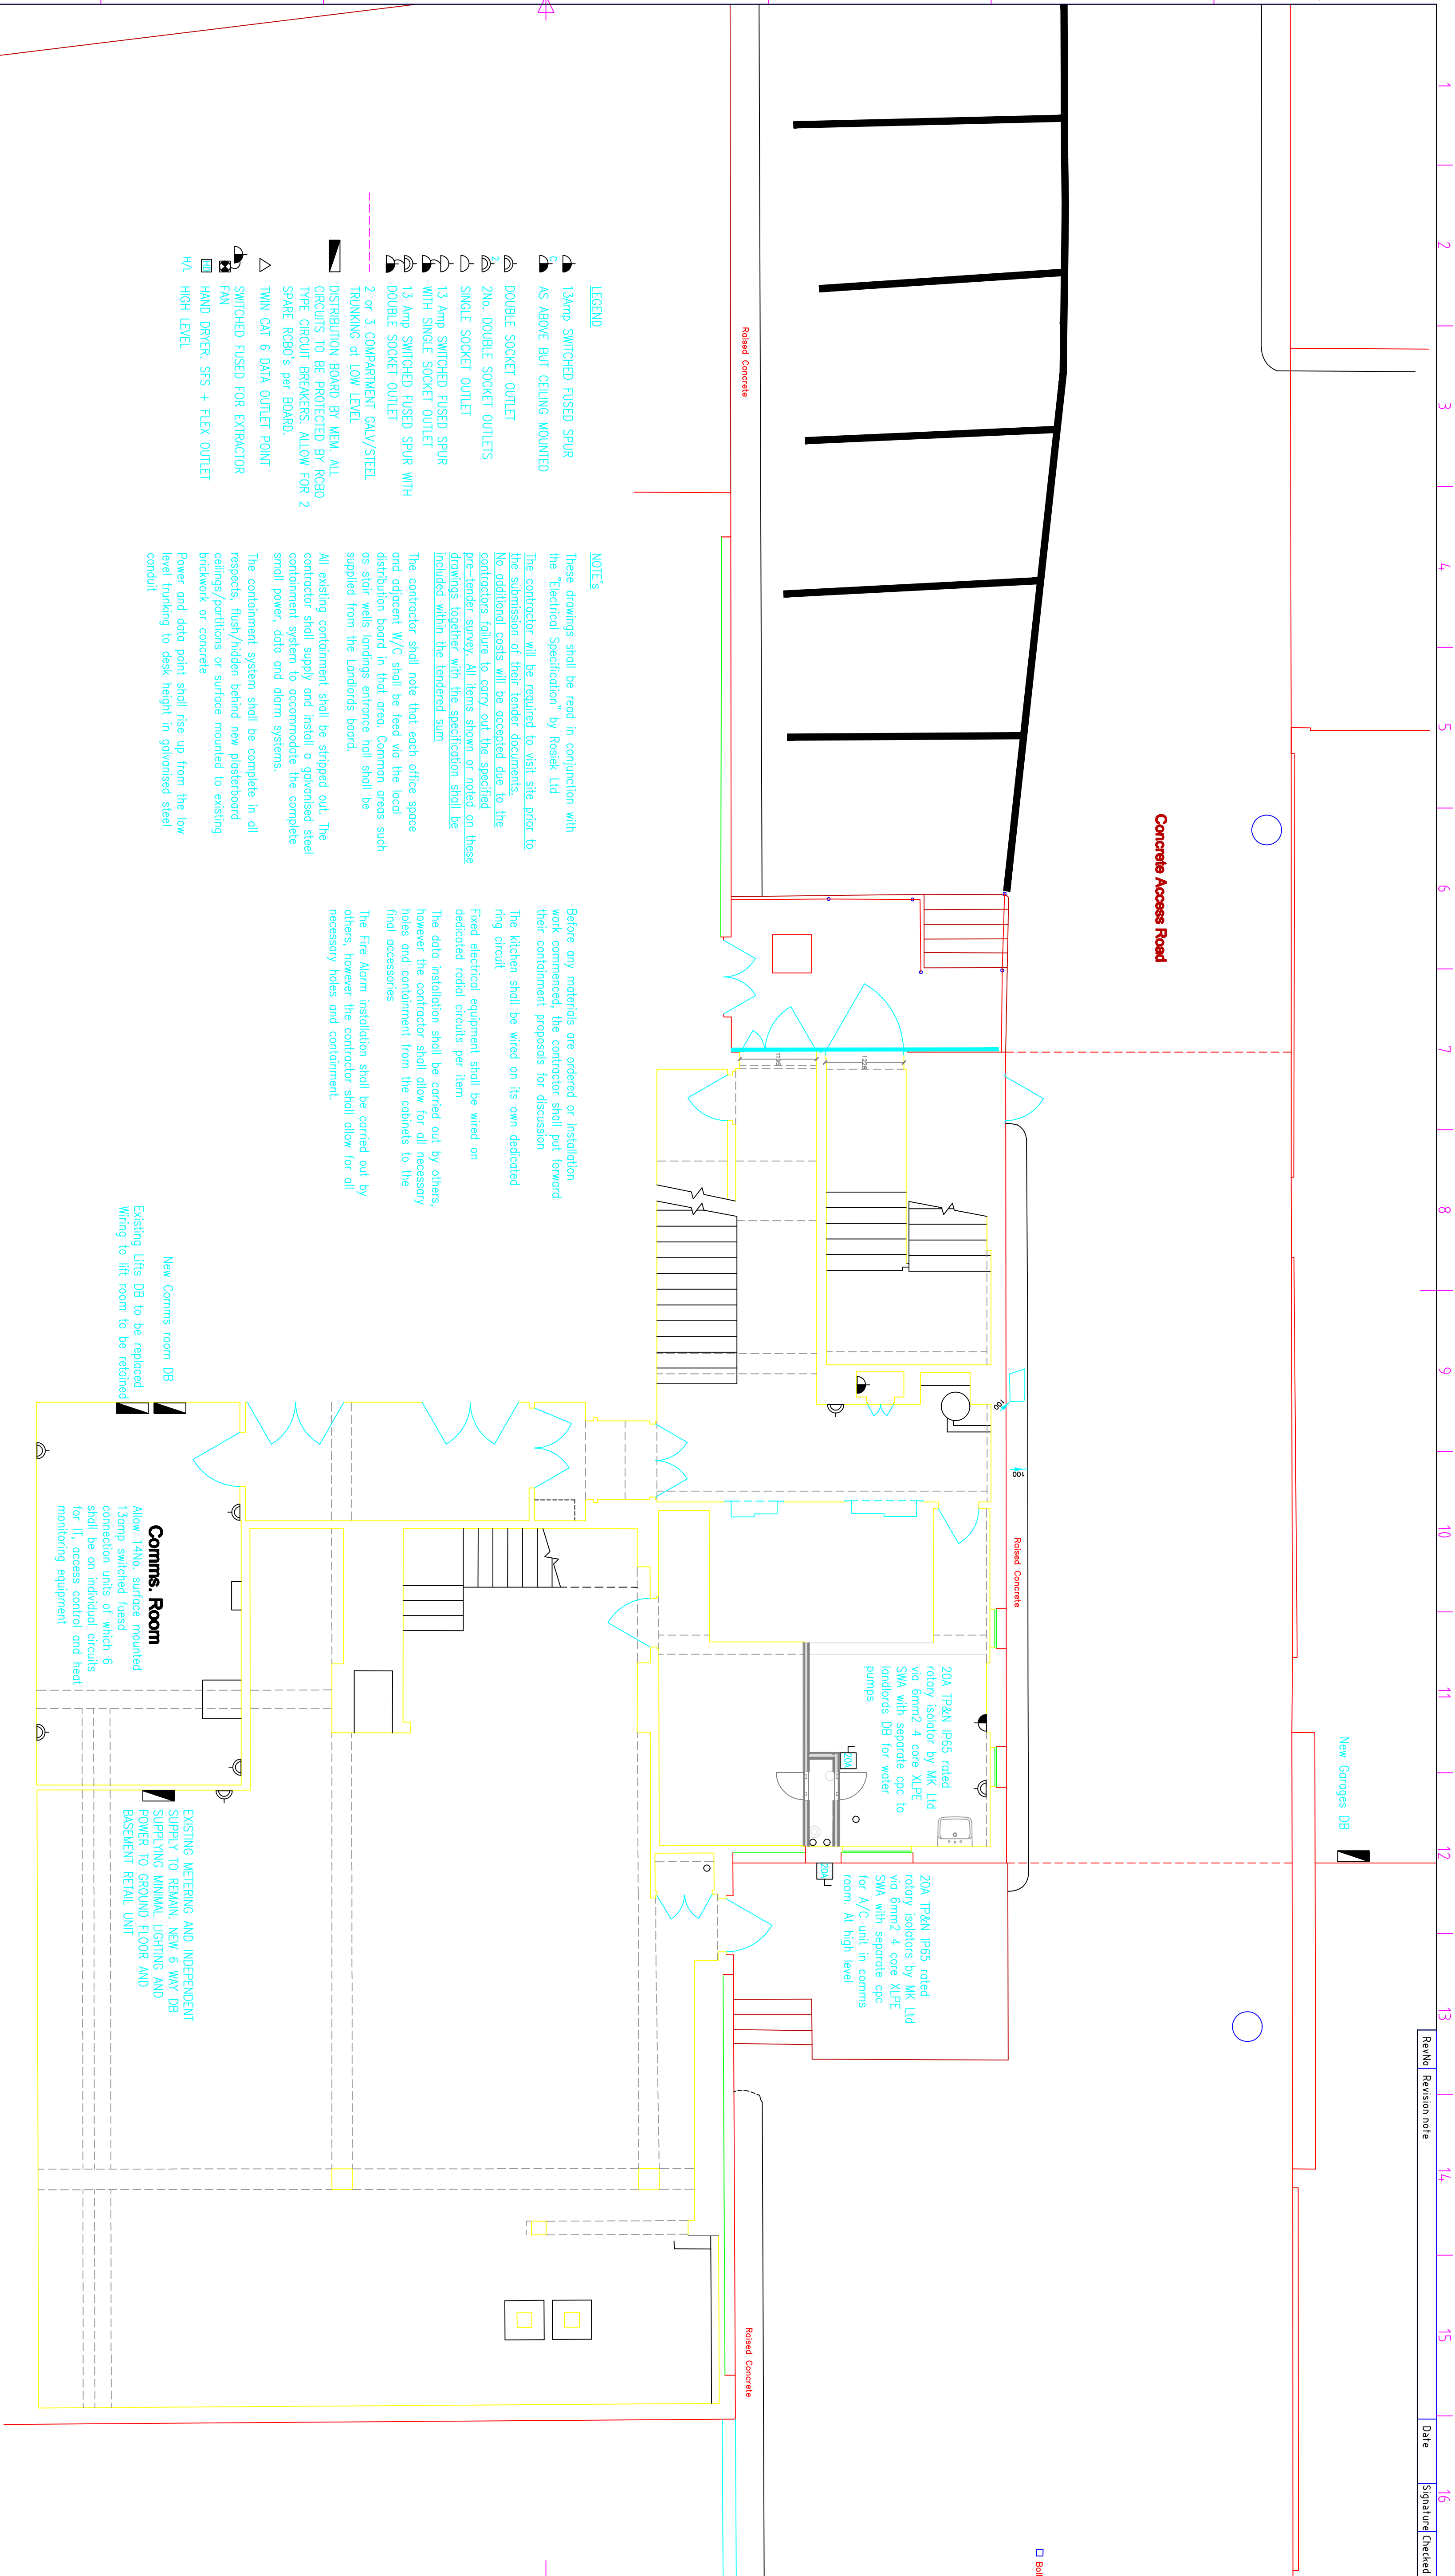

LEGEND

- 13amp SWITCHED FUSED SPUR AS ABOVE BUT CEILING MOUNTED
- DOUBLE SOCKET OUTLET
- 2No. DOUBLE SOCKET OUTLETS
- SINGLE SOCKET OUTLET
- 13 Amp SWITCHED FUSED SPUR WITH SINGLE SOCKET OUTLET
- DOUBLE SOCKET OUTLET
- 2 or 3 COMPARTMENT GALV/STEEL TRUNKING at LOW LEVEL
- DISTRIBUTION BOARD BY MK. ALL CIRCUITS TO BE PROTECTED BY RCBO TYPE CIRCUIT BREAKERS. ALLOW FOR 2 SPARE RCBO's per BOARD.
- TWIN CAT 6 DATA OUTLET POINT
- SWITCHED FUSED FOR EXTRACTOR FAN
- HAND DRIVER, SFS + FLEX OUTLET
- 1/4" HIGH LEVEL

NOTES

Before any materials are ordered or installation work commenced, the contractor shall put forward their containment proposals for discussion

The contractor will be required to visit site prior to the submission of their tender documents. No additional costs will be accepted due to the contractors failure to carry out the specified pre-tender survey. All items shown or noted on these drawings together with the specification shall be included within the tendered sum

The contractor shall note that each office space and adjacent W/C shall be feed via the local distribution board's 13amp Common Press such as stated loadings entrance hall shall be supplied from the landlords board.

All existing containment shall be stripped out. The contractor shall supply and install a galvanised steel containment system to accommodate the complete small power, data and alarm systems.

The containment system shall be complete in all respects, flush/hidden behind new plasterboard ceilings/partitions or surface mounted to existing brickwork or concrete

Power and data point shall rise up from the low level trunking to desk height in galvanised steel conduit